Butler County code requirments for underground service

(For Duke Energy customers only)

Inspection of underground will be made at the same time as the Power Release. Leave trench open, back fill with sand or grits 12" and have marker tape in trench for inspection.

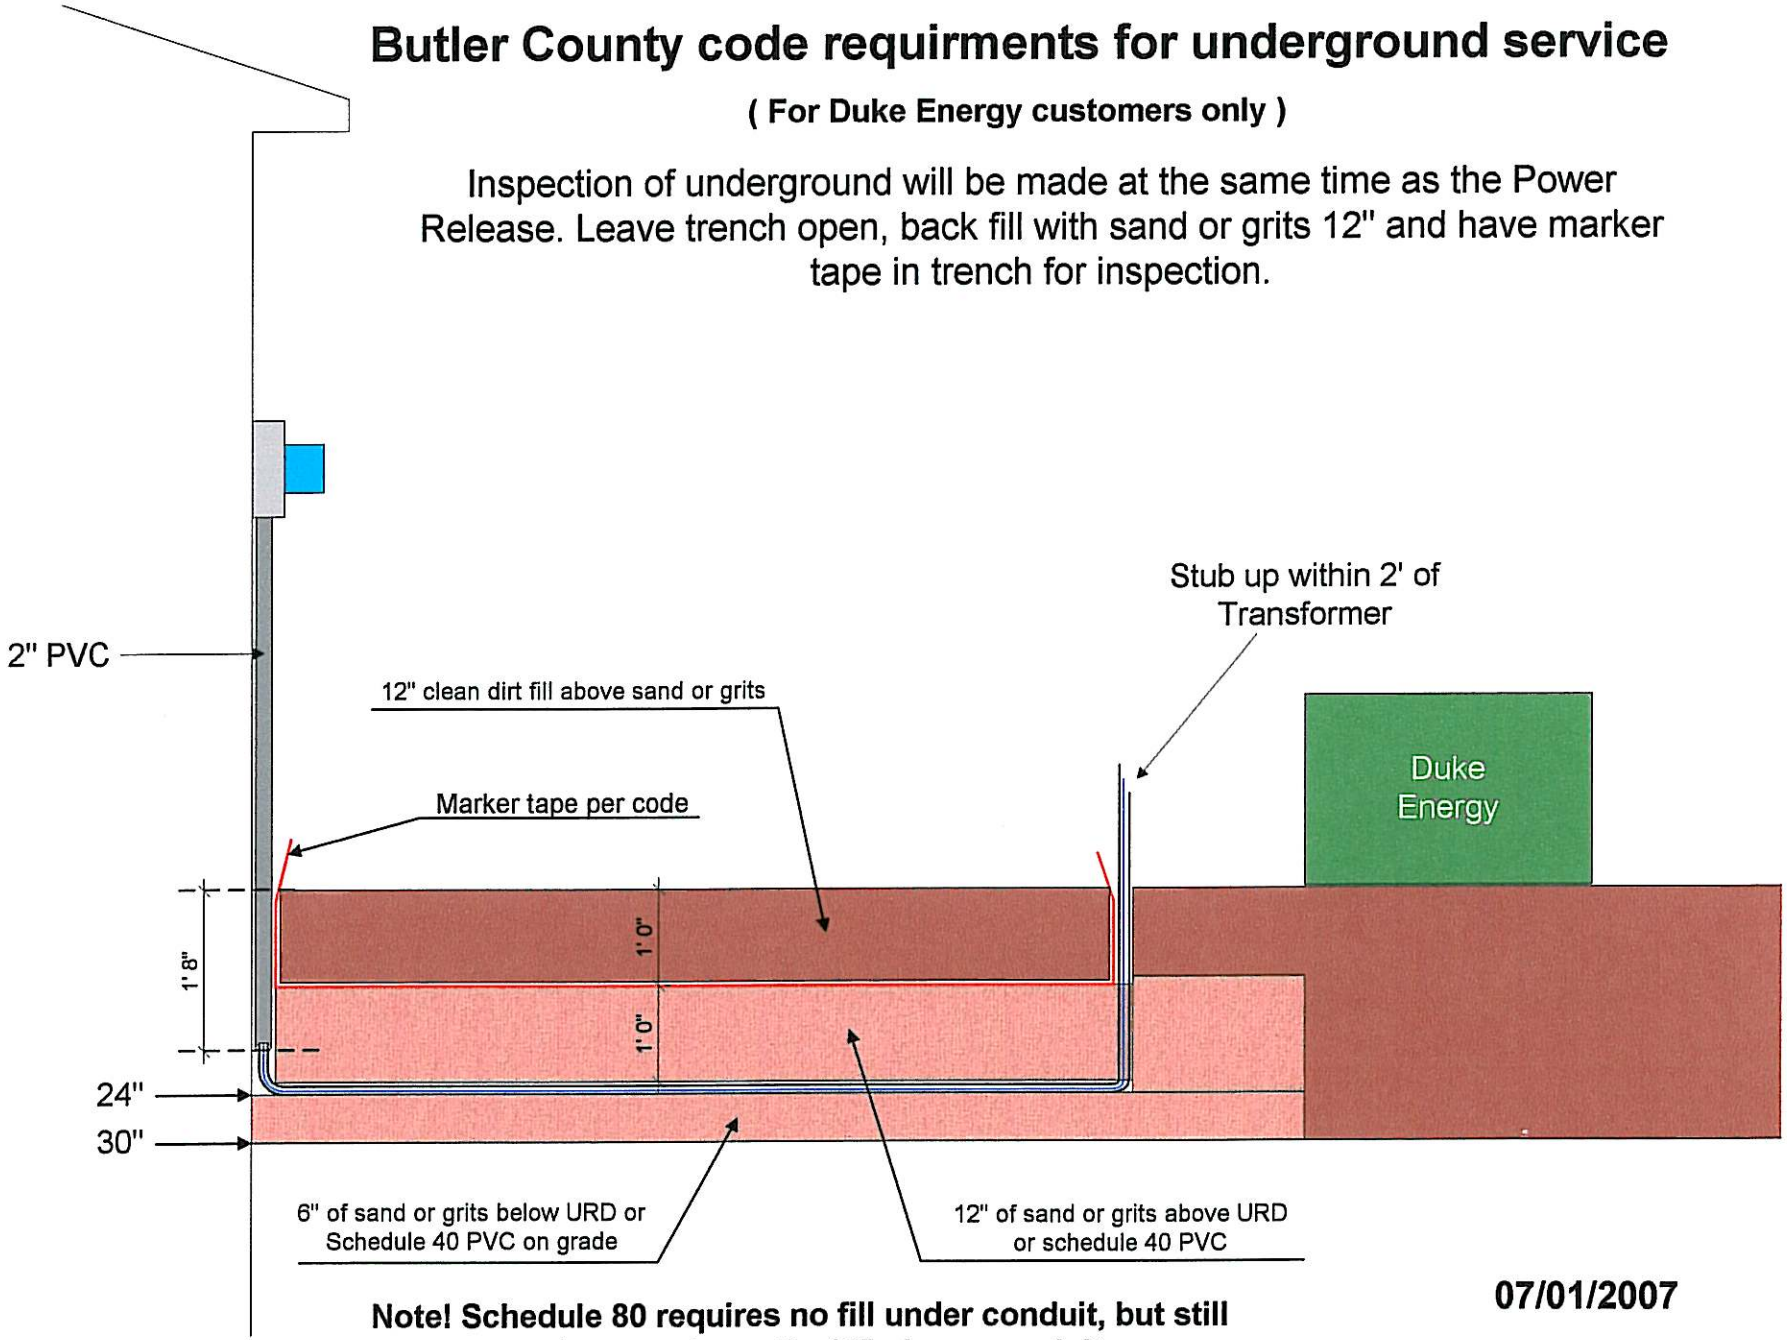

Note! Schedule 80 requires no fill under conduit, but still requires sand or grits 12" above conduit.

07/01/2007