


637

REVISED 2/03


SUPPORT FOR A 120/240V-1 $\phi$  OR 120/208V-1 $\phi$  THREE-WIRE TEMPORARY SERVICE, 200 AMPERES OR SMALLER, FROM AN OVERHEAD SUPPLY FOR USE DURING BUILDING CONSTRUCTION

PLAN VIEW

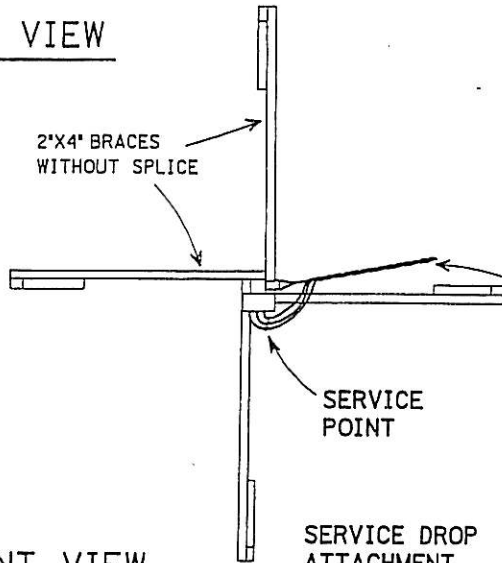

SERVICE SUPPORT		
SERVICE AMPACITY	DISTANCE FROM SUPPLY POLE	TIMBER SIZES *
100 AMP OR LESS	UP TO 75 FT.	1-4'x4' OR 2-2'x4' TIMBERS SPIKED TOGETHER
GREATER THAN 100 AMP UP TO 200 AMP	UP TO 40 FT.	1-4'x4' OR 2-2'x4' TIMBERS SPIKED TOGETHER
GREATER THAN 100 AMP UP TO 200 AMP	GREATER THAN 40 FT. UP TO 75 FT.	2-2'x6' TIMBERS SPIKED TOGETHER

FRONT VIEW

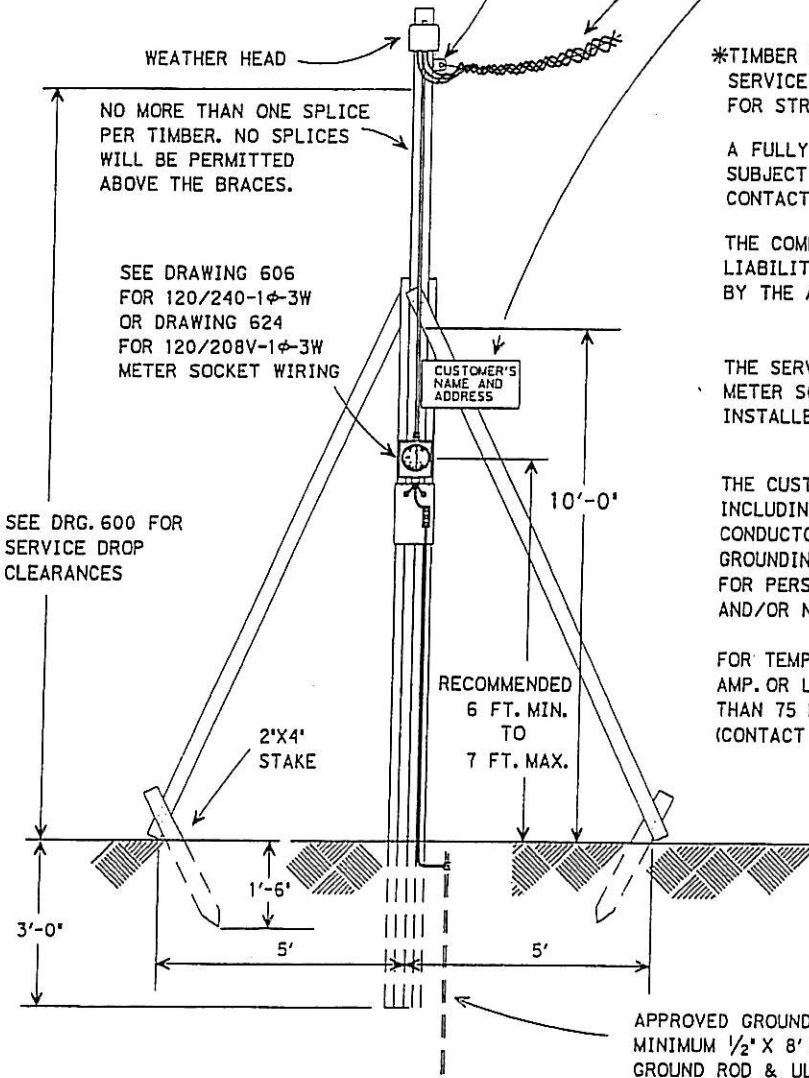

CONNECTORS, SERVICE-DROP AND FINAL CONNECTION ARE INSTALLED BY THE COMPANY.

ATTACH IDENTIFICATION SIGN TO THE CENTER POST AND BRACE ABOVE THE METER SOCKET AND FACE TOWARD THE ROAD.

GENERAL NOTES:

\*TIMBER SIZES SHOWN IN CHART FOR THE SERVICE SUPPORT ARE MINIMUM SIZES FOR STRENGTH REQUIRED.

A FULLY TREATED WOOD POLE MAY BE USED SUBJECT TO APPROVAL PRIOR TO INSTALLATION CONTACT ENERGY DELIVERY. (SEE ARTICLE 501C)

THE COMPANY ASSUMES NO RESPONSIBILITY & LIABILITY FOR FAILURE OF A SUPPORT CAUSED BY THE ATTACHMENT OF THE SERVICE-DROP.

THE SERVICE DROP ATTACHMENT DEVICE & METER SOCKET ARE FURNISHED AND INSTALLED BY THE CUSTOMER.

THE CUSTOMER MUST INSTALL ALL MATERIALS INCLUDING THE SERVICE SUPPORT, SERVICE CONDUCTORS, SERVICE DISCONNECT(S), SERVICE GROUNDING, AND ALL NECESSARY PROTECTION FOR PERSONNEL SAFETY REQUIRED BY LOCAL AND/OR NATIONAL CODES.

FOR TEMPORARY SERVICES GREATER THAN 200 AMP. OR LOCATED AT A DISTANCE GREATER THAN 75 FT. FROM A COMPANY SUPPLY POLE, (CONTACT ENERGY DELIVERY)

NO MORE THAN ONE SPLICE PER TIMBER. NO SPLICES WILL BE PERMITTED ABOVE THE BRACES.

SEE DRAWING 606 FOR 120/240-1 $\phi$ -3W OR DRAWING 624 FOR 120/208V-1 $\phi$ -3W METER SOCKET WIRING

SEE DRG. 600 FOR SERVICE DROP CLEARANCES

RECOMMENDED 6 FT. MIN. TO 7 FT. MAX.

APPROVED GROUNDING MINIMUM 1/2" X 8' COPPER CLAD GROUND ROD & UL LISTED CLAMP